




TYPICAL CHASSIS CLUTCH AND CONDENSER FAN CIRCUIT

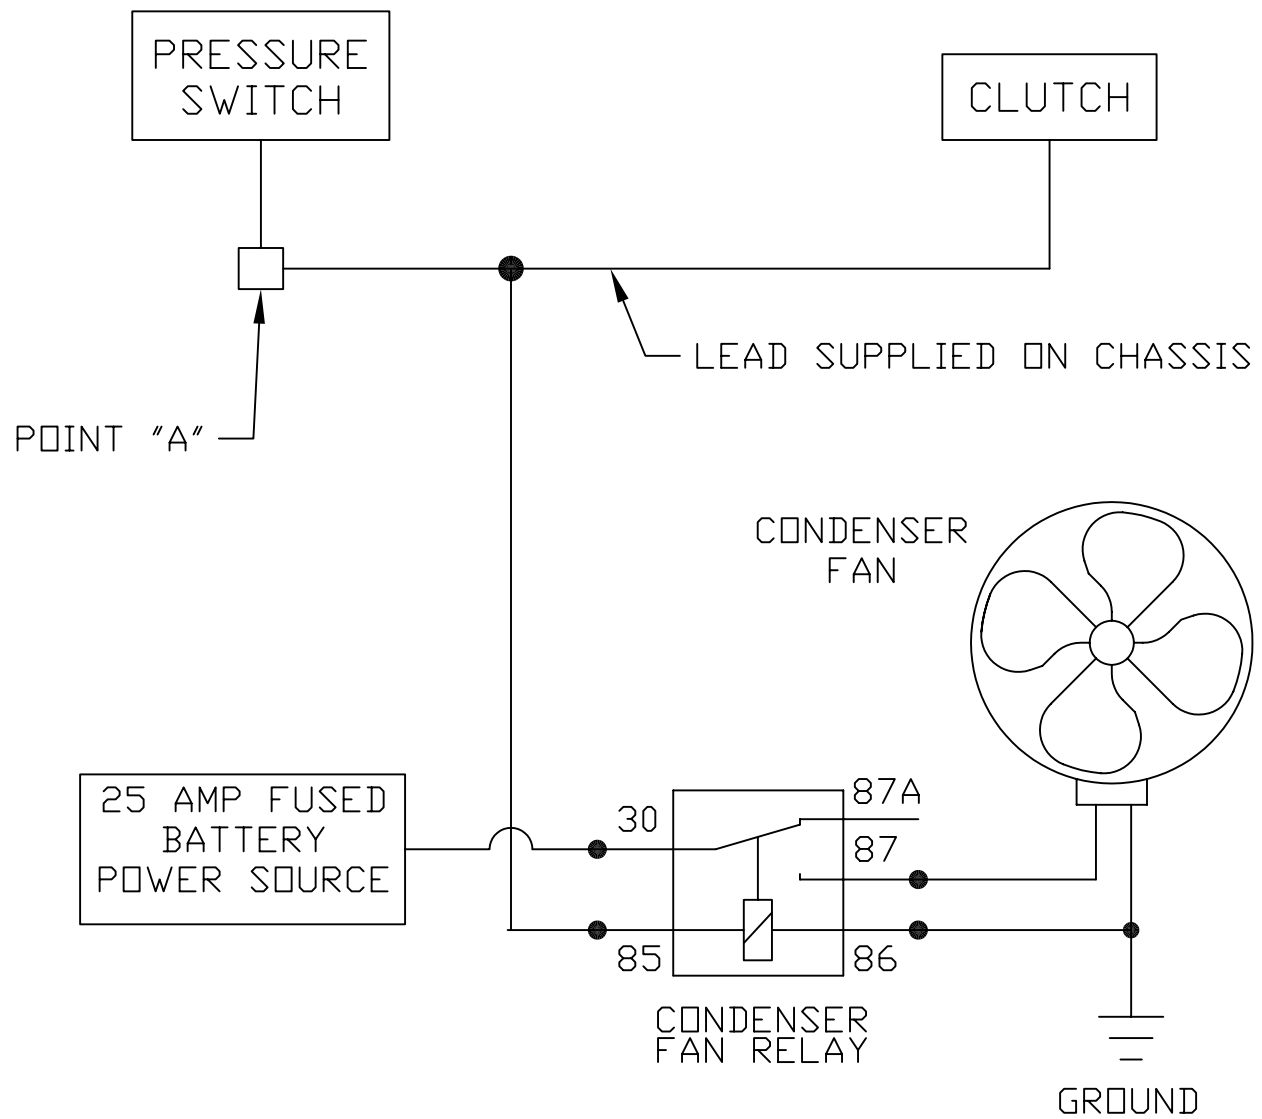

TEMPCON
701 ANN ST., N.W.
GRAND RAPIDS, MI 49504

EVANS HVAC SYSTEM WIRING DIAGRAM


CONTROL PANEL BACKSIDE

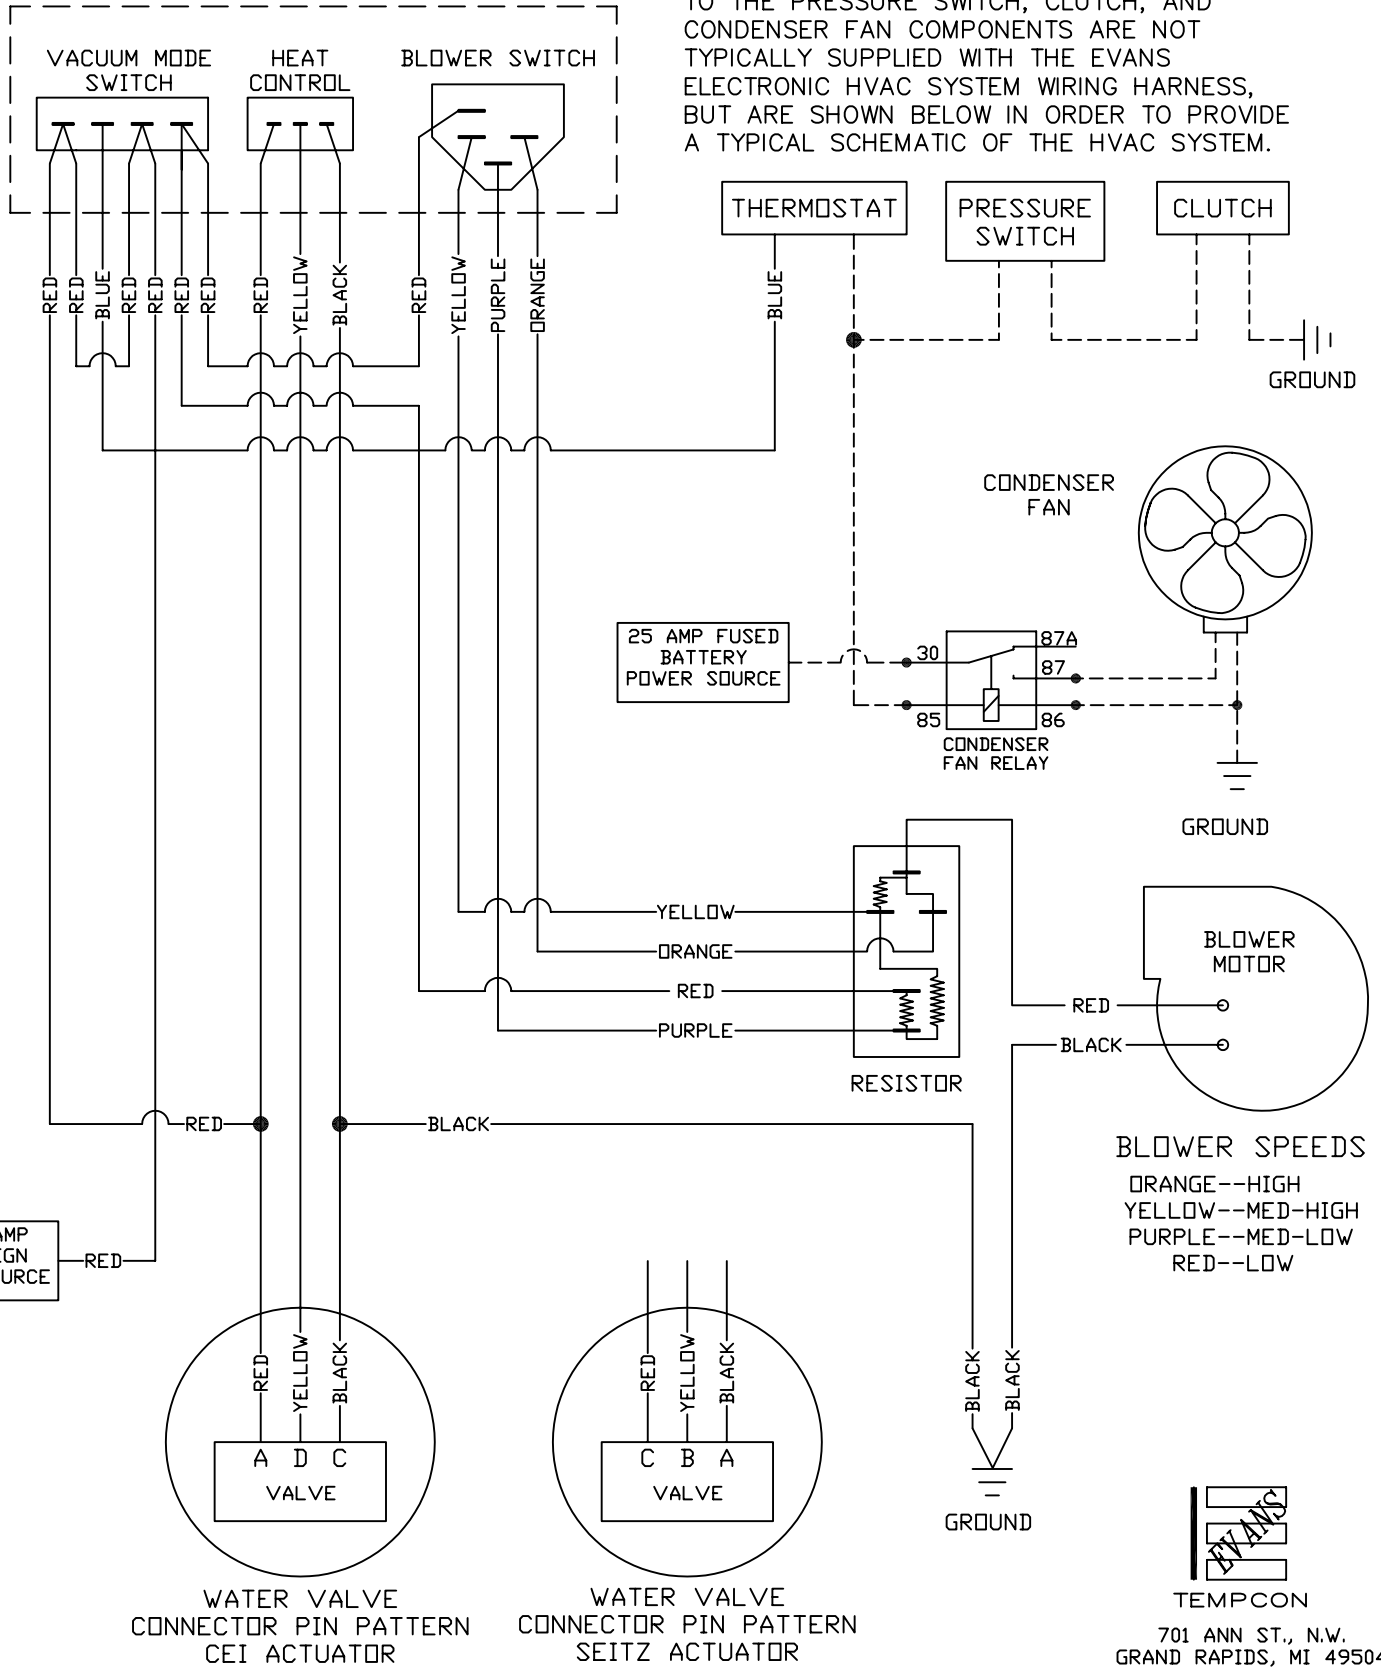


TEMPCON

701 ANN ST., N.W.
GRAND RAPIDS, MI 49504

TYPICAL ROTARY CABLE CONTROL PANEL GENERAL SCHEMATIC FOR MOST CHASSIS

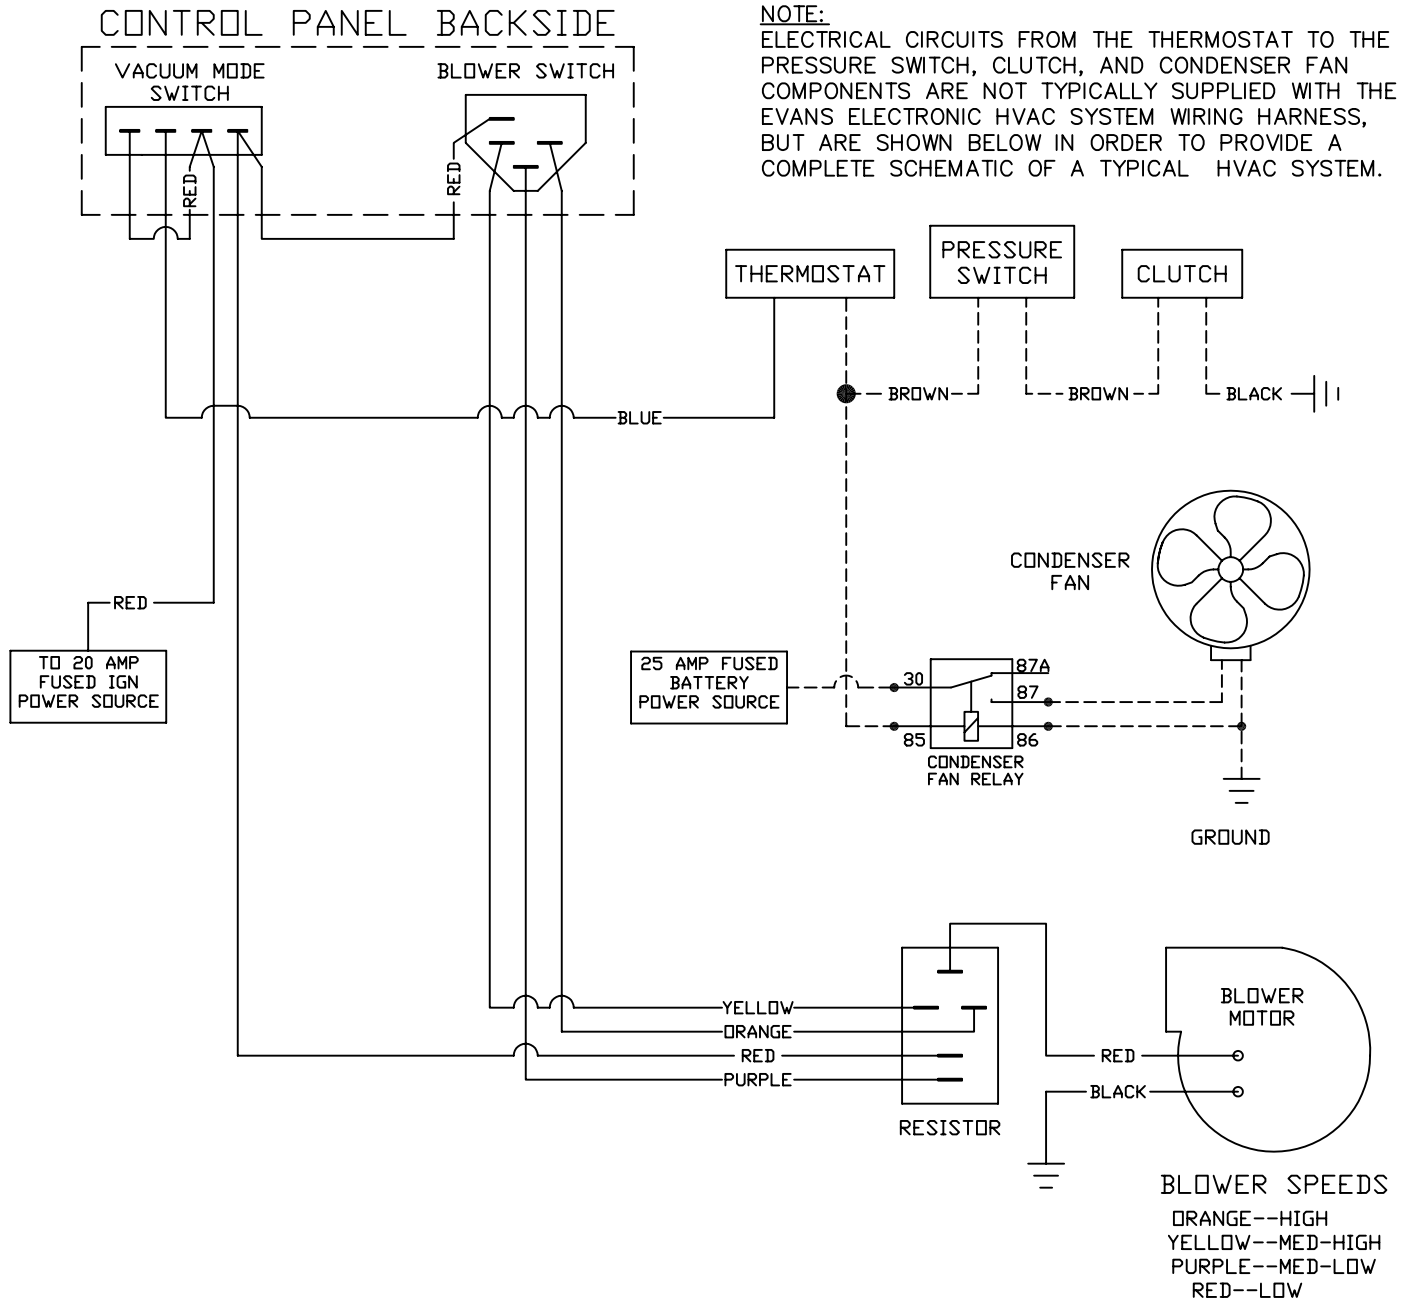

NOTE:
ELECTRICAL CIRCUITS FROM THE THERMOSTAT TO THE PRESSURE SWITCH, CLUTCH, AND CONDENSER FAN COMPONENTS ARE NOT TYPICALLY SUPPLIED WITH THE EVANS ELECTRONIC HVAC SYSTEM WIRING HARNESS, BUT ARE SHOWN BELOW IN ORDER TO PROVIDE A COMPLETE SCHEMATIC OF A TYPICAL HVAC SYSTEM.



TEMPCON

701 ANN ST., N.W.
GRAND RAPIDS, MI 49504